


Product Information

Flow Transmitter LABO-RRI-I / U / F / C

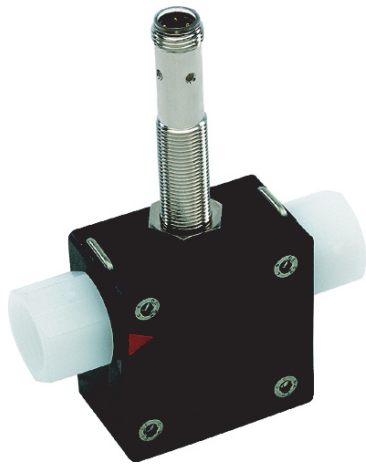

- Uncomplicated measurement of flow rates
- No magnets; uses inductive sensor
- Long working life thanks to high quality ceramic axis and special plastic bearing
- Run-in and run-out sections are not necessary.
- Modular construction with various connection systems
- Plug-in and rotatable connections
- 0..10 V, 4..20 mA, frequency/pulse output, completely configurable
- Optionally, non-return valve, filter, constant flow rate device in the connections

Characteristics

The flow meter consists of a spinner which is rotated by the flowing medium. The rotor's rotational speed is proportional to the flow volume per unit time. The rotor is fitted with stainless steel clamps (optionally titanium or Hastelloy®). An inductive proximity switch records the rotational speed, which is proportional to the flow rate.

The LABO-RRI electronics make various output signals available:

- Analog signal 0/4..20 mA (LABO-RRI-I)
- Analog signal 0/2..10 V (LABO-RRI-U)
- Frequency signal (LABO-RRI-F) or
- Value signal Pulse / x Litres (LABO-RRI-C)

A model with switching output is also available.


If desired, the range end value can be set to the currently existing flow using "teaching".

Technical data


| | | |
|--------------------------------------|---|---|
| Sensor | inductive | |
| Nominal width | DN 10 (FLEX-RRI-010) DN 25 (FLEX-RRI-025) | |
| Mechanical Connection | female thread G 3/8, G 1 male thread G 3/8 A, G 1 A hose nozzle Ø11, Ø30 (other threaded, crimped, and plug-in connections, connections with constant flow rate device or limiters available on request) | |
| Metering ranges | 0.1..100 l/min for details, see table "Ranges" | |
| Measurement accuracy | ±3 % of the measured value | |
| Repeatability | ±1 % of full scale value | |
| Pressure loss | max. 0.5 bar | |
| Pressure resistance | PN 16 bar | |
| Medium temperature | 0..60 °C | |
| Storage temperature | -20..+80 °C | |
| Materials medium-contact | Housing | PPS (Fortron 1140L4) |
| | Rotor | PVDF |
| | Clamps | 1.4310 optionally: titanium or Hastelloy® |
| | Bearing | Iglidur X |
| | Axis | Ceramic ZrO ₂ -TZP |
| | Seal | FKM |
| Materials, non-medium-contact | Clamps | 1.4301 |
| | Electronic housing | CW614N nickelled |
| Supply voltage | 10..30 V DC at voltage output 10 V: 15..30 V DC | |
| Power consumption | < 1 W (for no-load outputs) | |
| Output data: | all outputs are resistant to short circuits and reversal polarity protected | |
| Current output: | 4..20 mA (0..20 mA available on request) | |
| Voltage output: | 0..10 V (2..10 V available on request) | |
| Frequency output: | transistor output "push-pull" I _{out} = 100 mA max. output frequency dependent on metering range, standard 500 Imp/l (corresponds to 666.7 Hz at 80 l/min) Rrange for small values: 5000 Imp/l (corresponds to 500 Hz at 6 l/min) (other frequencies available on request) | |
| Pulse output: | transistor output "push-pull" I _{out} = 100 mA max. pulse width 50 ms pulse per volume is to be stated | |
| Display | yellow LCD shows operating voltage (LABO-RRI-I / U) or output status (LABO-RRI-F / C) (rapid flashing = Programming) | |
| Electrical connection | for round plug connector M12x1, 4-pole | |
| Ingress protection | IP 67 | |
| Weight | LABO-RRI-010 | approx. 0.2 kg |
| | LABO-RRI-025 | approx. 0.5 kg |
| Conformity | CE | |

Product Information


Signal output curves

Value x = Begin of the specified range
 = not specified range


Current output



Voltage output



Frequency output




f_{max} selectable in the range of up to 2000 Hz

Other characters on request.


Ranges

| Metering range l/min (H ₂ O) | Types | Q _{max} l/min (H ₂ O) |
|--|--------------------|--|
| 0.1.. 1.5 | LABO-RRI-010...020 | 1.8 |
| 0.2.. 10.0 | LABO-RRI-010...050 | 12.0 |
| 0.4.. 12.0 | LABO-RRI-010...070 | 14.4 |
| 2.0.. 30.0 | LABO-RRI-025...080 | 36.0 |
| 3.0.. 60.0 | LABO-RRI-025...120 | 72.0 |
| 4.0..100.0 | LABO-RRI-025...160 | 120.0 |

Wiring

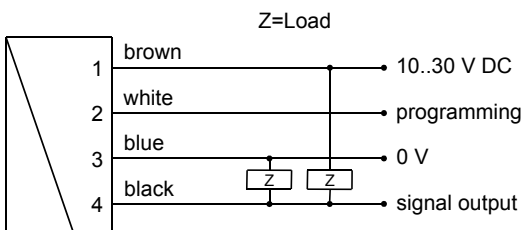

Connection example: PNP NPN




Before the electrical installation, it must be ensured that the supply voltage corresponds to the data sheet.

It is recommended to use shielded wiring.

The push-pull output) of the frequency output version can as desired be switched as a PNP or an NPN output.

Dimensions

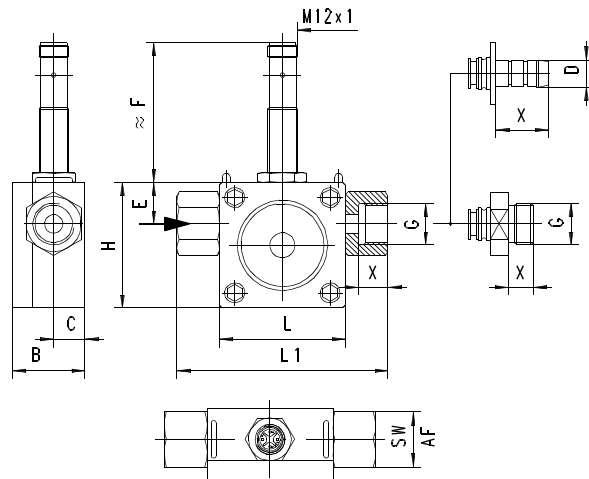

Threaded connection

| G | DN | Types | H/L | L1 | B | C | E | F | X | SW |
|---------|----|----------|-----|-----|----|------|------|----|----|----|
| G 3/8 | 10 | RRI-010G | 50 | 84 | 29 | 12.5 | 16.5 | 56 | 12 | 22 |
| G 3/8 A | | RRI-010A | | | | | | | 14 | |
| G 1 | 25 | RRI-025G | 70 | 110 | 53 | 23.0 | 27.5 | 51 | 18 | 38 |
| G 1 A | | RRI-025A | | 122 | | | | | | |

NPT threads on request

Hose nozzle connection

| D | DN | Types | H/L | L1 | B | C | E | F | X |
|-----|----|----------|-----|-----|----|------|------|----|----|
| Ø11 | 10 | RRI-010T | 50 | 96 | 29 | 12.5 | 16.5 | 56 | 21 |
| Ø30 | 25 | RRI-025T | 70 | 176 | 53 | 23.0 | 27.5 | 51 | 45 |

Custom specific connectors on request

Handling and operation

Installation

The Rotatron device is installed in the pipework with the aid of the rotatable adapter pieces. If necessary, the adapters can be removed from the body of the housing after the stainless steel clips have been removed from the housing. Before reinstalling, it should be ensured that both the adapter with the O-ring and the sealing surface in the body are clean and undamaged. The adapters should be fitted carefully in the housing (it is best to turn them), so that the O-ring is not damaged.

With this flow sensor, there is no need for run-in and run-out sections. However, it should be ensured that the flow sensor is at all times filled with medium. Any preferred installation position is possible, but the best possible venting position should be chosen (rotor axis horizontal, flow horizontal or from bottom to top).

Air bubbles affect the measurement results. For filling processes, the valve should be installed behind the sensor. A running up time of approx. 0.5 seconds and a running down time of approx. 3 seconds should be noted.

Product Information

Note

The metering range end value can be programmed by the user via "teaching". Requirement for programmability must be stated when ordering, otherwise the device cannot be programmed. The ECI-1 device configurator with associated software is available as a convenient option for programming all parameters by PC, and for adjustment.

The teaching option is not available for the pulse output version.

Operation and programming

The teaching process can be carried out by the user as follows:

- The flow rate to be set is applied to the device.
- Apply an impulse of at least 0.5 seconds and max. 2 seconds duration to pin 2 (e.g. via a bridge to the supply voltage or a pulse from the PLC), in order to accept the measured value.
- When the teaching is complete, pin 2 should be connected to 0 V, so as to prevent unintended programming.

The devices have a yellow LED which flashes during the programming pulse. During operation, the LED serves as an indicator of operating voltage (for analog output) or of switching status (for frequency or pulse output).

In order to avoid the need to transit to an undesired operating status during the teach-in, the device can be provided ex-works with a teach-offset. The teach-offset point is added to the currently measured value before saving. The offset point can be positive or negative.

Example: The end of the metering range should be set to 80 %. However, only 60 % can be achieved without problem. In this case, the device would be ordered with a "teach-offset" of +20%.. At a flow rate of 60 % in the process, teaching would then store a value of 80 %.

If necessary, a far greater number of parameters can also be programmed using the ECI-1 device configurator.

Ordering code

The basic device is ordered e.g. RRI-010xxx with electronics e.g. LABO-RRI-010xxx

RRI- 1. 2. 3. 4. 5. 6. 7. 8. 9. **E**

LABO-RRI- 10. 11. 12.

○=Option

| | | |
|----------------------------------|--|---|
| 1. Nominal width | | |
| 010 | DN 10 | |
| 025 | DN 25 | |
| 2. Mechanical connection | | |
| G | female thread | |
| A | male thread | |
| T | hose nozzle | |
| 3. Connection material | | |
| V | PVDF | |
| M | <input type="radio"/> CW614N nickelled | |
| K | <input type="radio"/> 1.4305 | |
| 4. Housing material | | |
| Q | PPS | |
| V | PVDF | |
| A | <input type="radio"/> PPS with transparent cover PSU | |
| 5. Inwards flow drilling | | |
| 020 | Ø 2.0 | • |
| 050 | Ø 5.0 | • |
| 070 | Ø 7.0 | • |
| 080 | Ø 8.0 | • |
| 120 | Ø12.0 | • |
| 160 | Ø16.0 | • |
| 6. Seal material | | |
| V | FKM | |
| E | <input type="radio"/> EPDM | |
| N | <input type="radio"/> NBR | |
| 7. Rotor | | |
| 10 | with 10 clamps | |
| 02 | <input type="radio"/> with 2 clamps | |
| 05 | <input type="radio"/> with 5 clamps | |
| 8. Material for clamps | | |
| K | 1.4310 | |
| T | <input type="radio"/> titanium | |
| H | <input type="radio"/> Hastelloy® | |
| 9. Connection for | | |
| E | electronics | |
| 10. Signal output | | |
| I | current output 4..20 mA | |
| U | voltage output 0..10 V | |
| F | frequency output (see "Ordering information") | |
| C | pulse output (see "Ordering information") | |
| 11. Programming | | |
| N | cannot be programmed (no teaching) | |
| P | <input type="radio"/> programmable (teaching possible) | |
| 12. Electrical connection | | |
| S | for round plug connector M12x1, 4-pole | |

Product Information

LABO-RRI-I / U / F / C

Required ordering information

For LABO-RRI-F:

Output frequency at full scale

 Hz

Maximum value: 2.000 Hz

For LABO-RRI-C:

For the pulse output version, the volume (with numerical value and unit) which will correspond to one pulse must be stated.

Volume per pulse (numerical value)

Volume per pulse (unit)

Options for LABO

Special range for analog output:

<= metering range (standard=metering range)

 l/min

Special range for frequency output:

<= metering range (standard=metering range)

 l/min

Power-On delay period (0..99 s)

(time after applying power during which the outputs are not activated or set to defined values)

 s

Further options available on request.

Options

- Rotor with titanium clamps

Accessories

- Cable/round plug connector (KB...) see additional information "Accessories"
- Evaluation electronics OMNI-TA
- Device configurator ECI-1